


INSTALLATION OF TEMPORARY DOUBLE CHECK DETECTOR ASSEMBLY REQUIRED PRIOR TO CONSTRUCTION OF NEW WATER FACILITIES

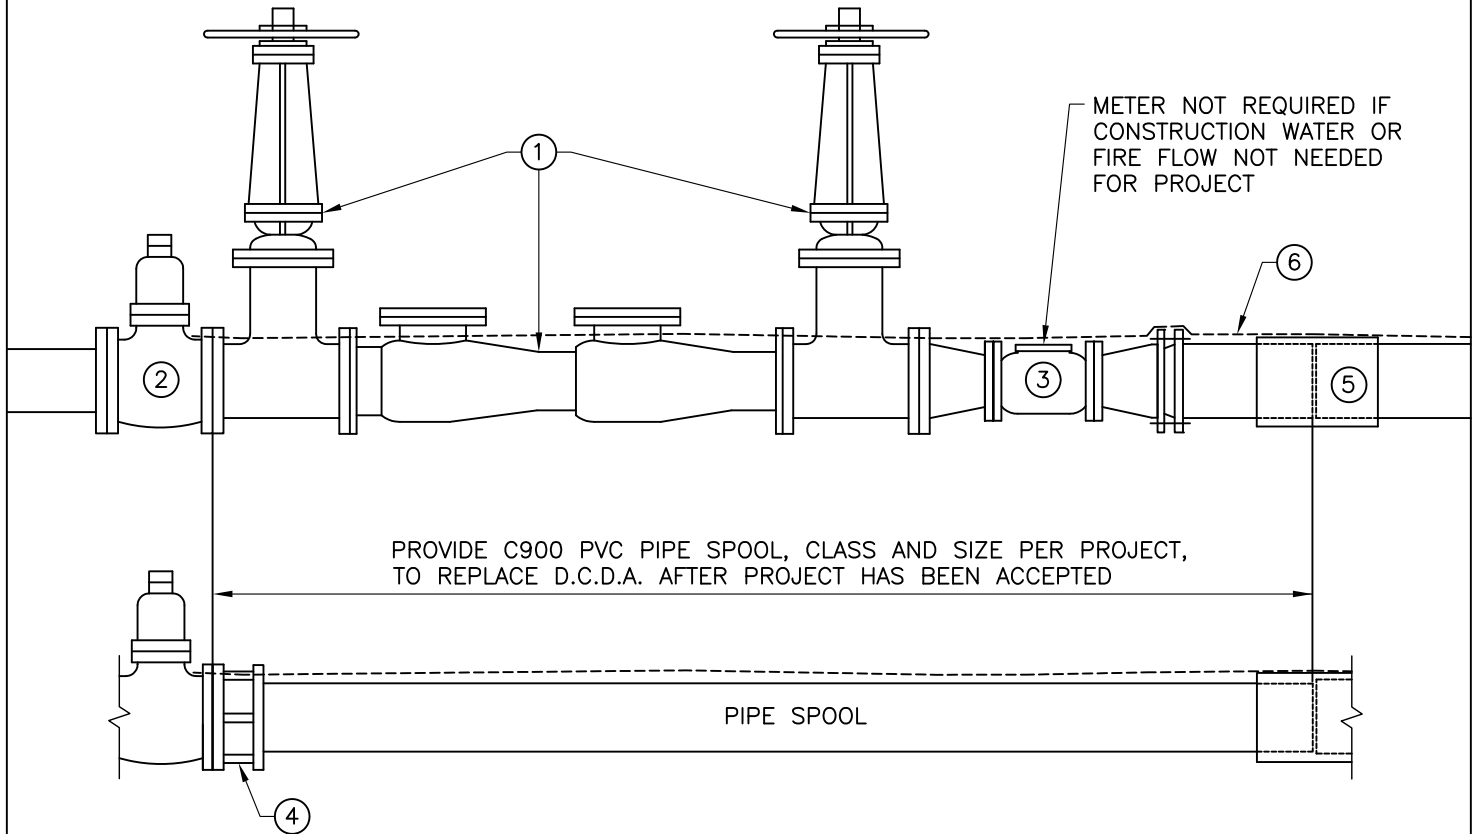

NOTES

- A. DETECTOR CHECK DETECTOR ASSEMBLY (D.C.D.A.) SHALL BE ON THE CURRENT STATE-APPROVED LIST. SEE T.U.D. FOR LIST.
- B. COAT BURIED NUTS & BOLTS WITH KOPPERS BITUMASTIC NO. 50, NAPA #MAC8400 RUBBERIZED UNDERCOAT, OR TAPE WITH 10 MILS PVC TAPE, 3 WRAPS MIN. AND COVER WITH PLASTIC SHEETING, 4 MIL THICK MIN. BOLTS MUST BE ACCESSIBLE.
- C. CONTRACTOR IS RESPONSIBLE FOR SUPPORTING AND PROTECTING D.C.D.A. AND METER UNTIL PROJECT HAS BEEN COMPLETED AND ACCEPTED BY T.U.D.

ITEM	QTY	DESCRIPTION
①	1	APPROVED DOUBLE CHECK DETECTOR ASSEMBLY
②	1	RESILIENT WEDGE GATE VALVE, SEE DWG. #201
③	1	4" TURBINE METER WITH 6"x4" FLxFL REDUCER & 4"x8" FLxMJ REDUCER
④	1	FLANGExCOUPLING ADAPTER
⑤	1	C900 COUPLING
⑥		#12 AWG INSULATED LOCATOR WIRE, SINGLE STRAND COPPER, <u>UF LISTED</u> , SEE DWG. #102

**TUOLUMNE UTILITIES DISTRICT
DOUBLE CHECK DETECTOR ASSEMBLY
FOR PROJECT UNDER CONSTRUCTION**

REV. 08-07-12
STD. DWG. NO.
211