


**INSTALLATION OF TEMPORARY DOUBLE CHECK DETECTOR ASSEMBLY
REQUIRED PRIOR TO CONSTRUCTION OF NEW WATER FACILITIES.**

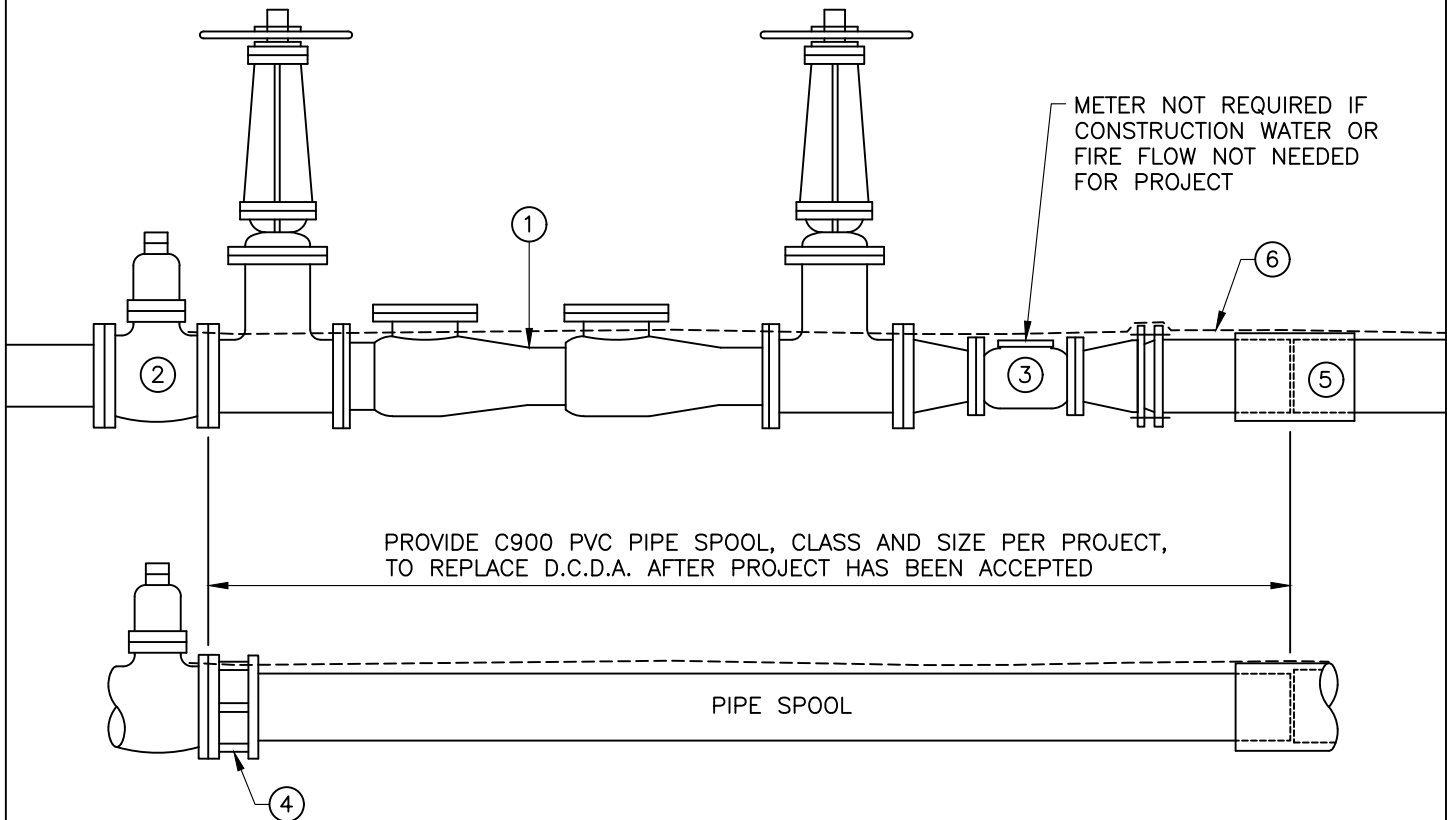

NOTES

- A. DOUBLE CHECK DETECTOR ASSEMBLY (D.C.D.A.) SHALL BE ON THE CURRENT STATE-APPROVED LIST. SEE T.U.D. FOR LIST.
- B. COAT BURIED NUTS & BOLTS WITH KOPPERS BITUMASTIC NO. 50 OR NAPA #MAC8400 RUBBERIZED UNDERCOAT.
- C. WRAP ALL FITTINGS, BOLTS, AND NUTS WITH 8 MIL. MIN. POLYETHYLENE SHEETING AND SECURE WITH 3 WRAPS OF 10 MIL. TAPE. COMPLETE WRAPPING PRIOR TO CONCRETE PLACEMENT. KEEP FITTINGS, BOLTS, NUTS, AND THREADS FREE OF CONCRETE AT ALL TIMES.
- D. CONTRACTOR IS RESPONSIBLE FOR SUPPORTING AND PROTECTING D.C.D.A. AND METER UNTIL PROJECT HAS BEEN COMPLETED AND ACCEPTED BY T.U.D.

ITEM	QTY	DESCRIPTION
①	1	APPROVED DOUBLE CHECK DETECTOR ASSEMBLY
②	1	RESILIENT WEDGE GATE VALVE, SEE DWG. 201
③	1	4" TURBINE METER WITH 6"x4" FLxFL REDUCER & 4"x8" FL x MJ REDUCER
④	1	FLANGE x COUPLING ADAPTER
⑤	1	C900 COUPLING
⑥		#12 AWG INSULATED LOCATOR WIRE, SINGLE STRAND COPPER, SEE DWG. 102

**TUOLUMNE UTILITIES DISTRICT
DOUBLE CHECK DETECTOR ASSEMBLY
FOR PROJECT UNDER CONSTRUCTION**

REV. 10-16-26

STD. DWG. NO.

211